


TERRY'S HVAC SYSTEM SKETCH (NOT TO SCALE) TOP VIEW

HOUSE MAIN RETURN AIR DUCTS

(HOUSE = SPLIT FOYER 50 yrs OLD)

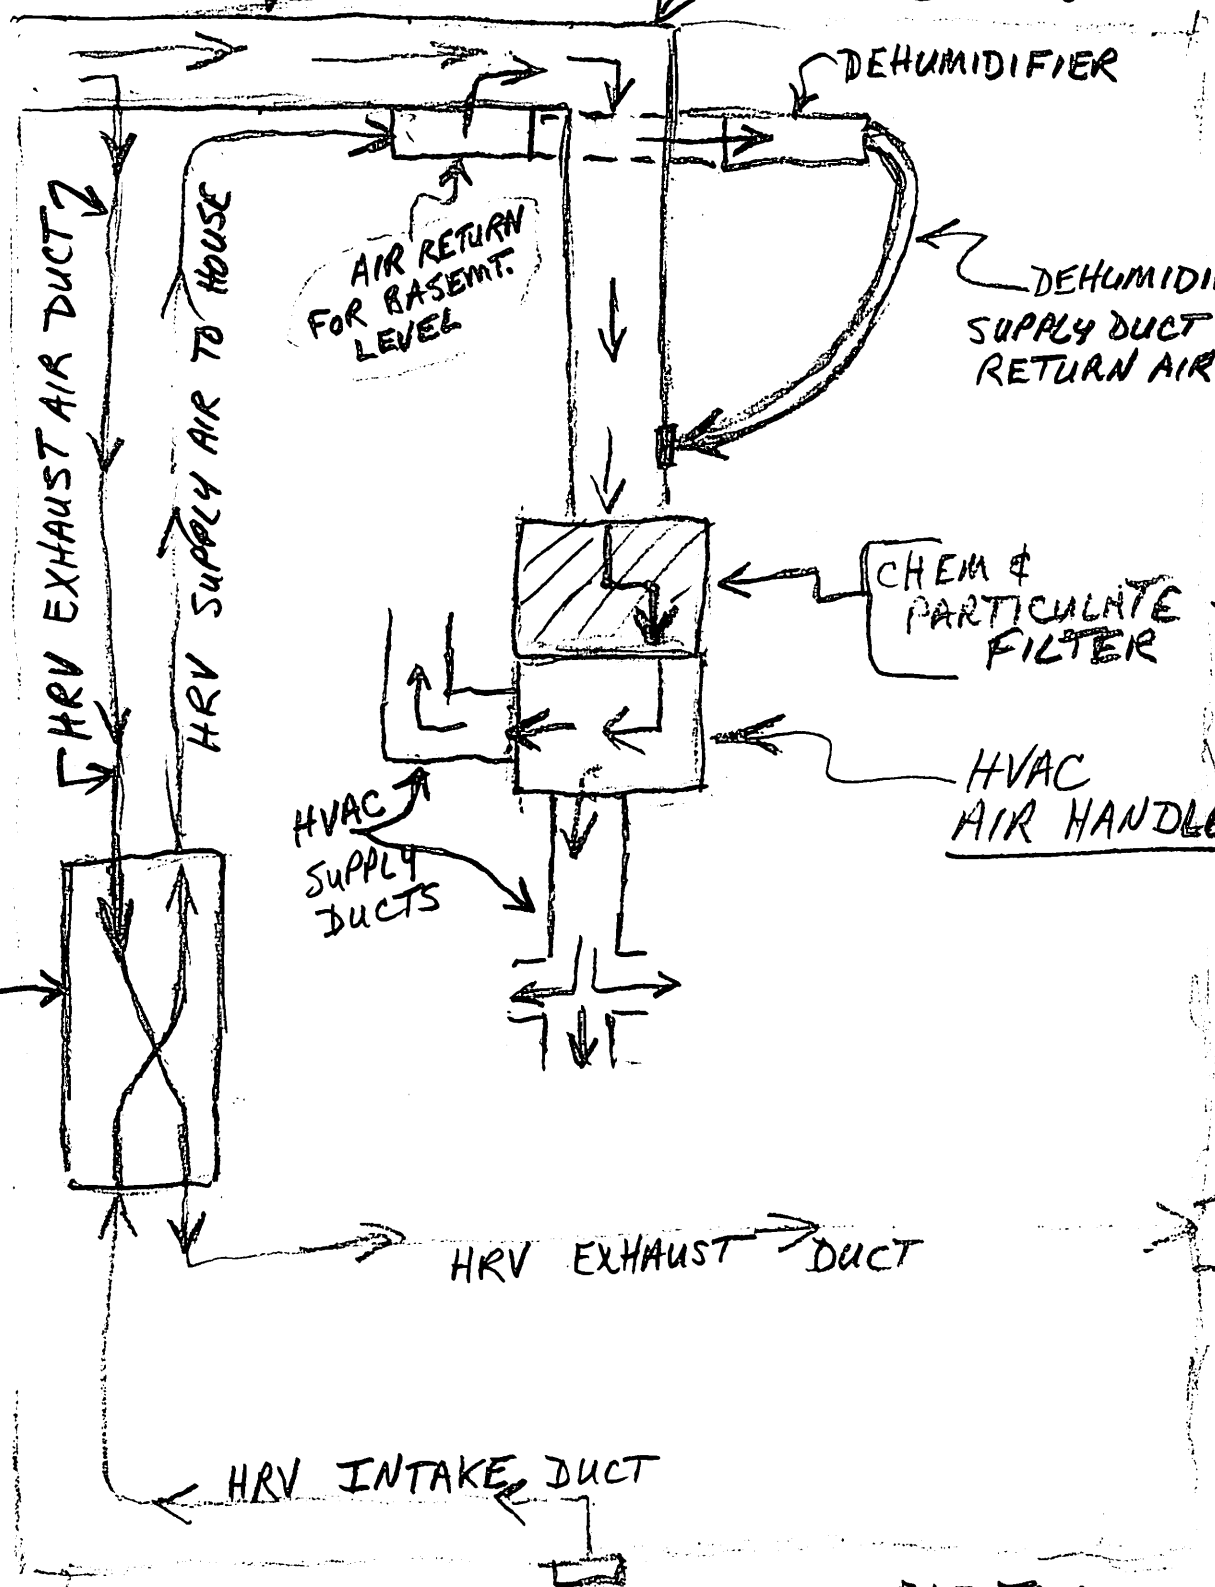

AIR RETURN FOR BASEMENT LEVEL

DEHUMIDIFIER 10" d. SUPPLY DUCT TO HOUSE RETURN AIR PLENUM

CHEM & PARTICULATE AIR FILTER

HVAC AIR HANDLER

HVAC SUPPLY DUCTS

HRV

HRV EXHAUST DUCT

HRV INTAKE DUCT

ELECTRIC HEAT PUMP

BASEMENT LEVEL = 3' BELOW GRADE

TERRY HVAC SYSTEM - FRONT VIEW OF HOW ERV SUPPLY AIR & DEHUMIDIFIER ARE DUCTED INTO HOUSE MAIN RETURN AIR DUCTS IN BASEMENT LEVEL OF SPLIT Foyer HOUSE

