

DISCLAIMER:
 The calculated values shown in this report are based on the data input by the user of the software. Inaccurate or erroneous data input will result in inaccurate or erroneous results. You are strongly advised to review all input data carefully, and to have the calculated results reviewed by an experienced heating professional to ensure reasonableness and suitability for your application.

PROJECT: **54** CUSTOMER:

PROJECT NO.: **45**

SCALE: **3/16"=1'**


DRAWING NAME: **P1 (Basement)**

DRAWN BY:


DATE: **8/19/2019**

REVISIONS

No	Desc	Date

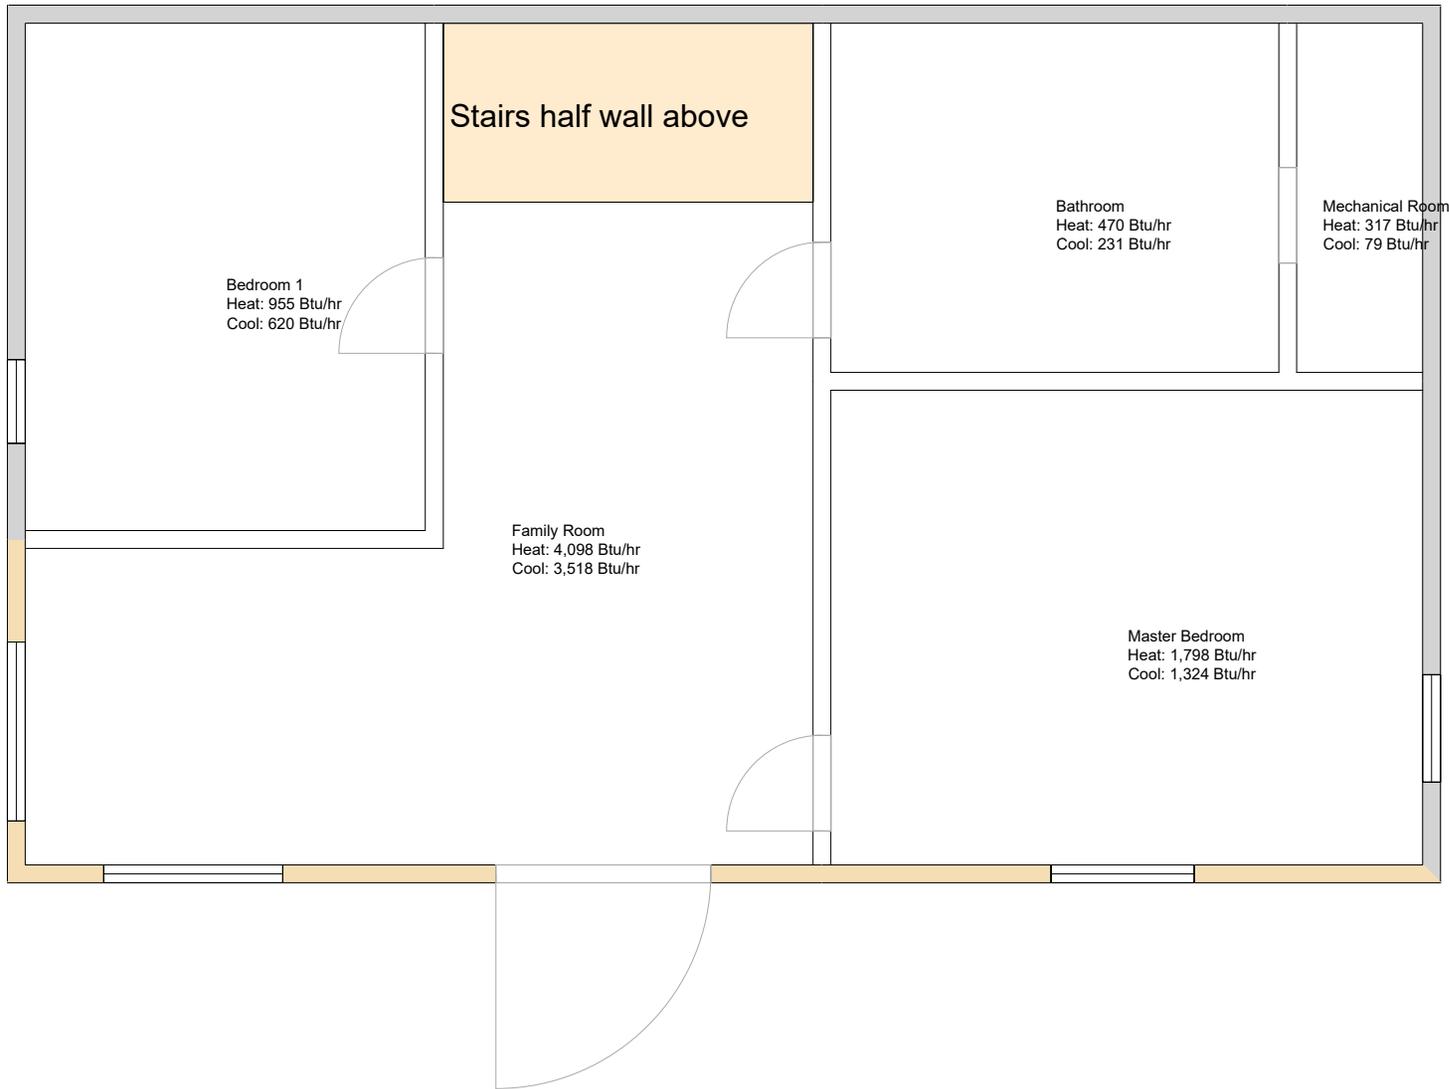

DISCLAIMER:
The calculated values shown in this report are based on the data input by the user of the software. Inaccurate or erroneous data input will result in inaccurate or erroneous results. You are strongly advised to review all input data carefully, and to have the calculated results reviewed by an experienced heating professional to ensure reasonableness and suitability for your application.

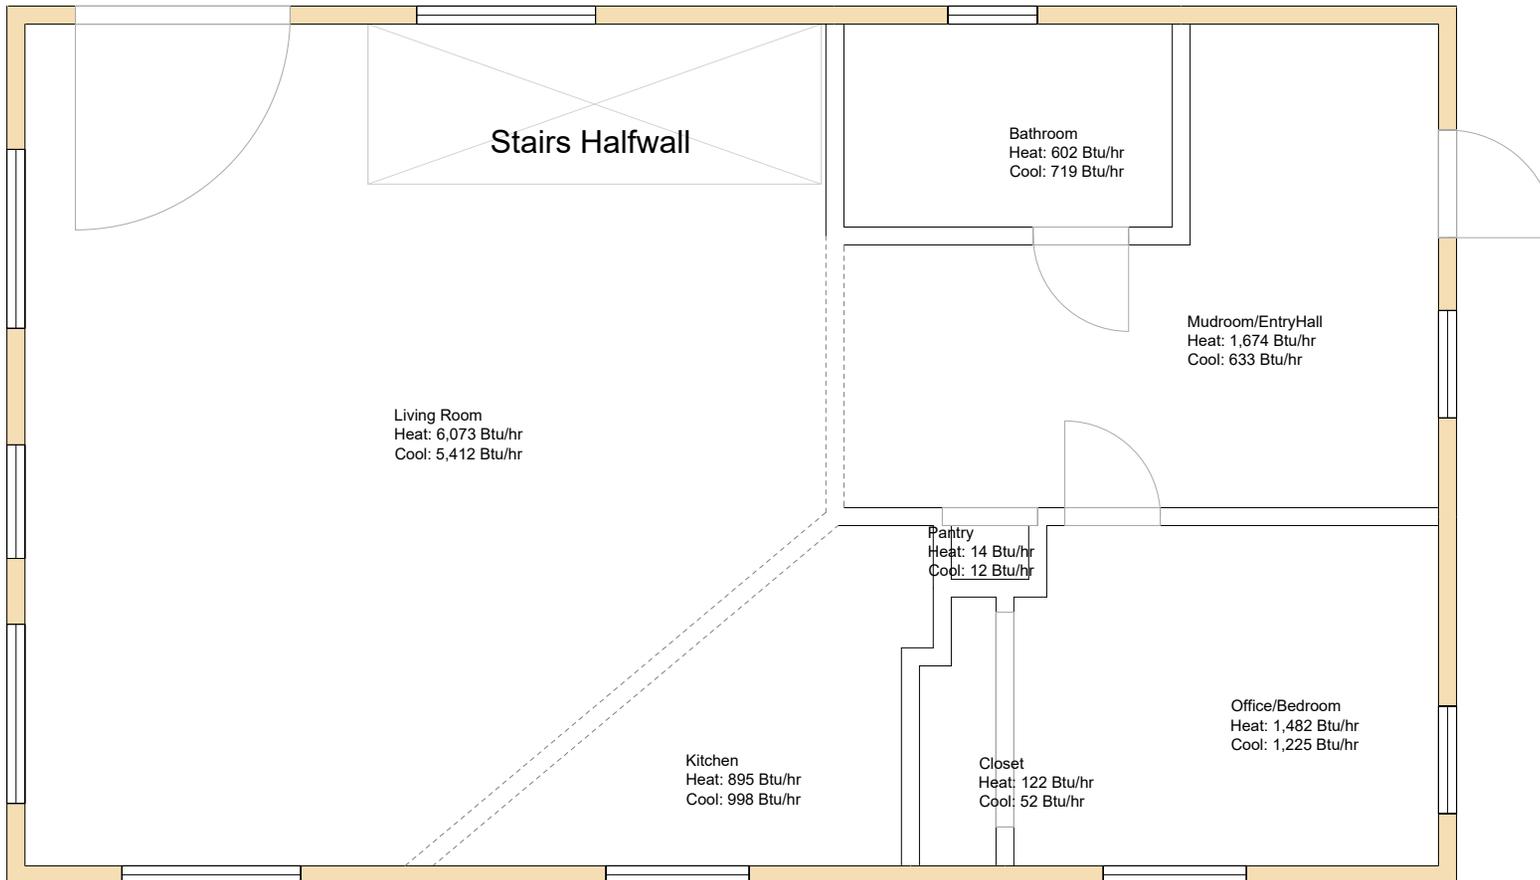

PROJECT: **54** CUSTOMER:

PROJECT NO.: **45**

SCALE: **3/16"=1'**

DRAWING NAME: **P2 (Main Floor)**

DRAWN BY:

DATE: **8/19/2019**

REVISIONS

No	Desc	Date