


RF-1

R48

R-38* / R-48 REQ. IN CLIMATE ZONE 5
(WHERE INSUL. IS CONTINUOUS AT
WALL TOP PLATE IRC N1102.2.1)

ROOF R-VALUE IS CALCULATED
BASED ON TOTAL ROOF
ASSEMBLY INCLUDING A 22%
FRAMING FACTOR

BASE R-VALUE: 61
EFFECTIVE R-VALUE: 48

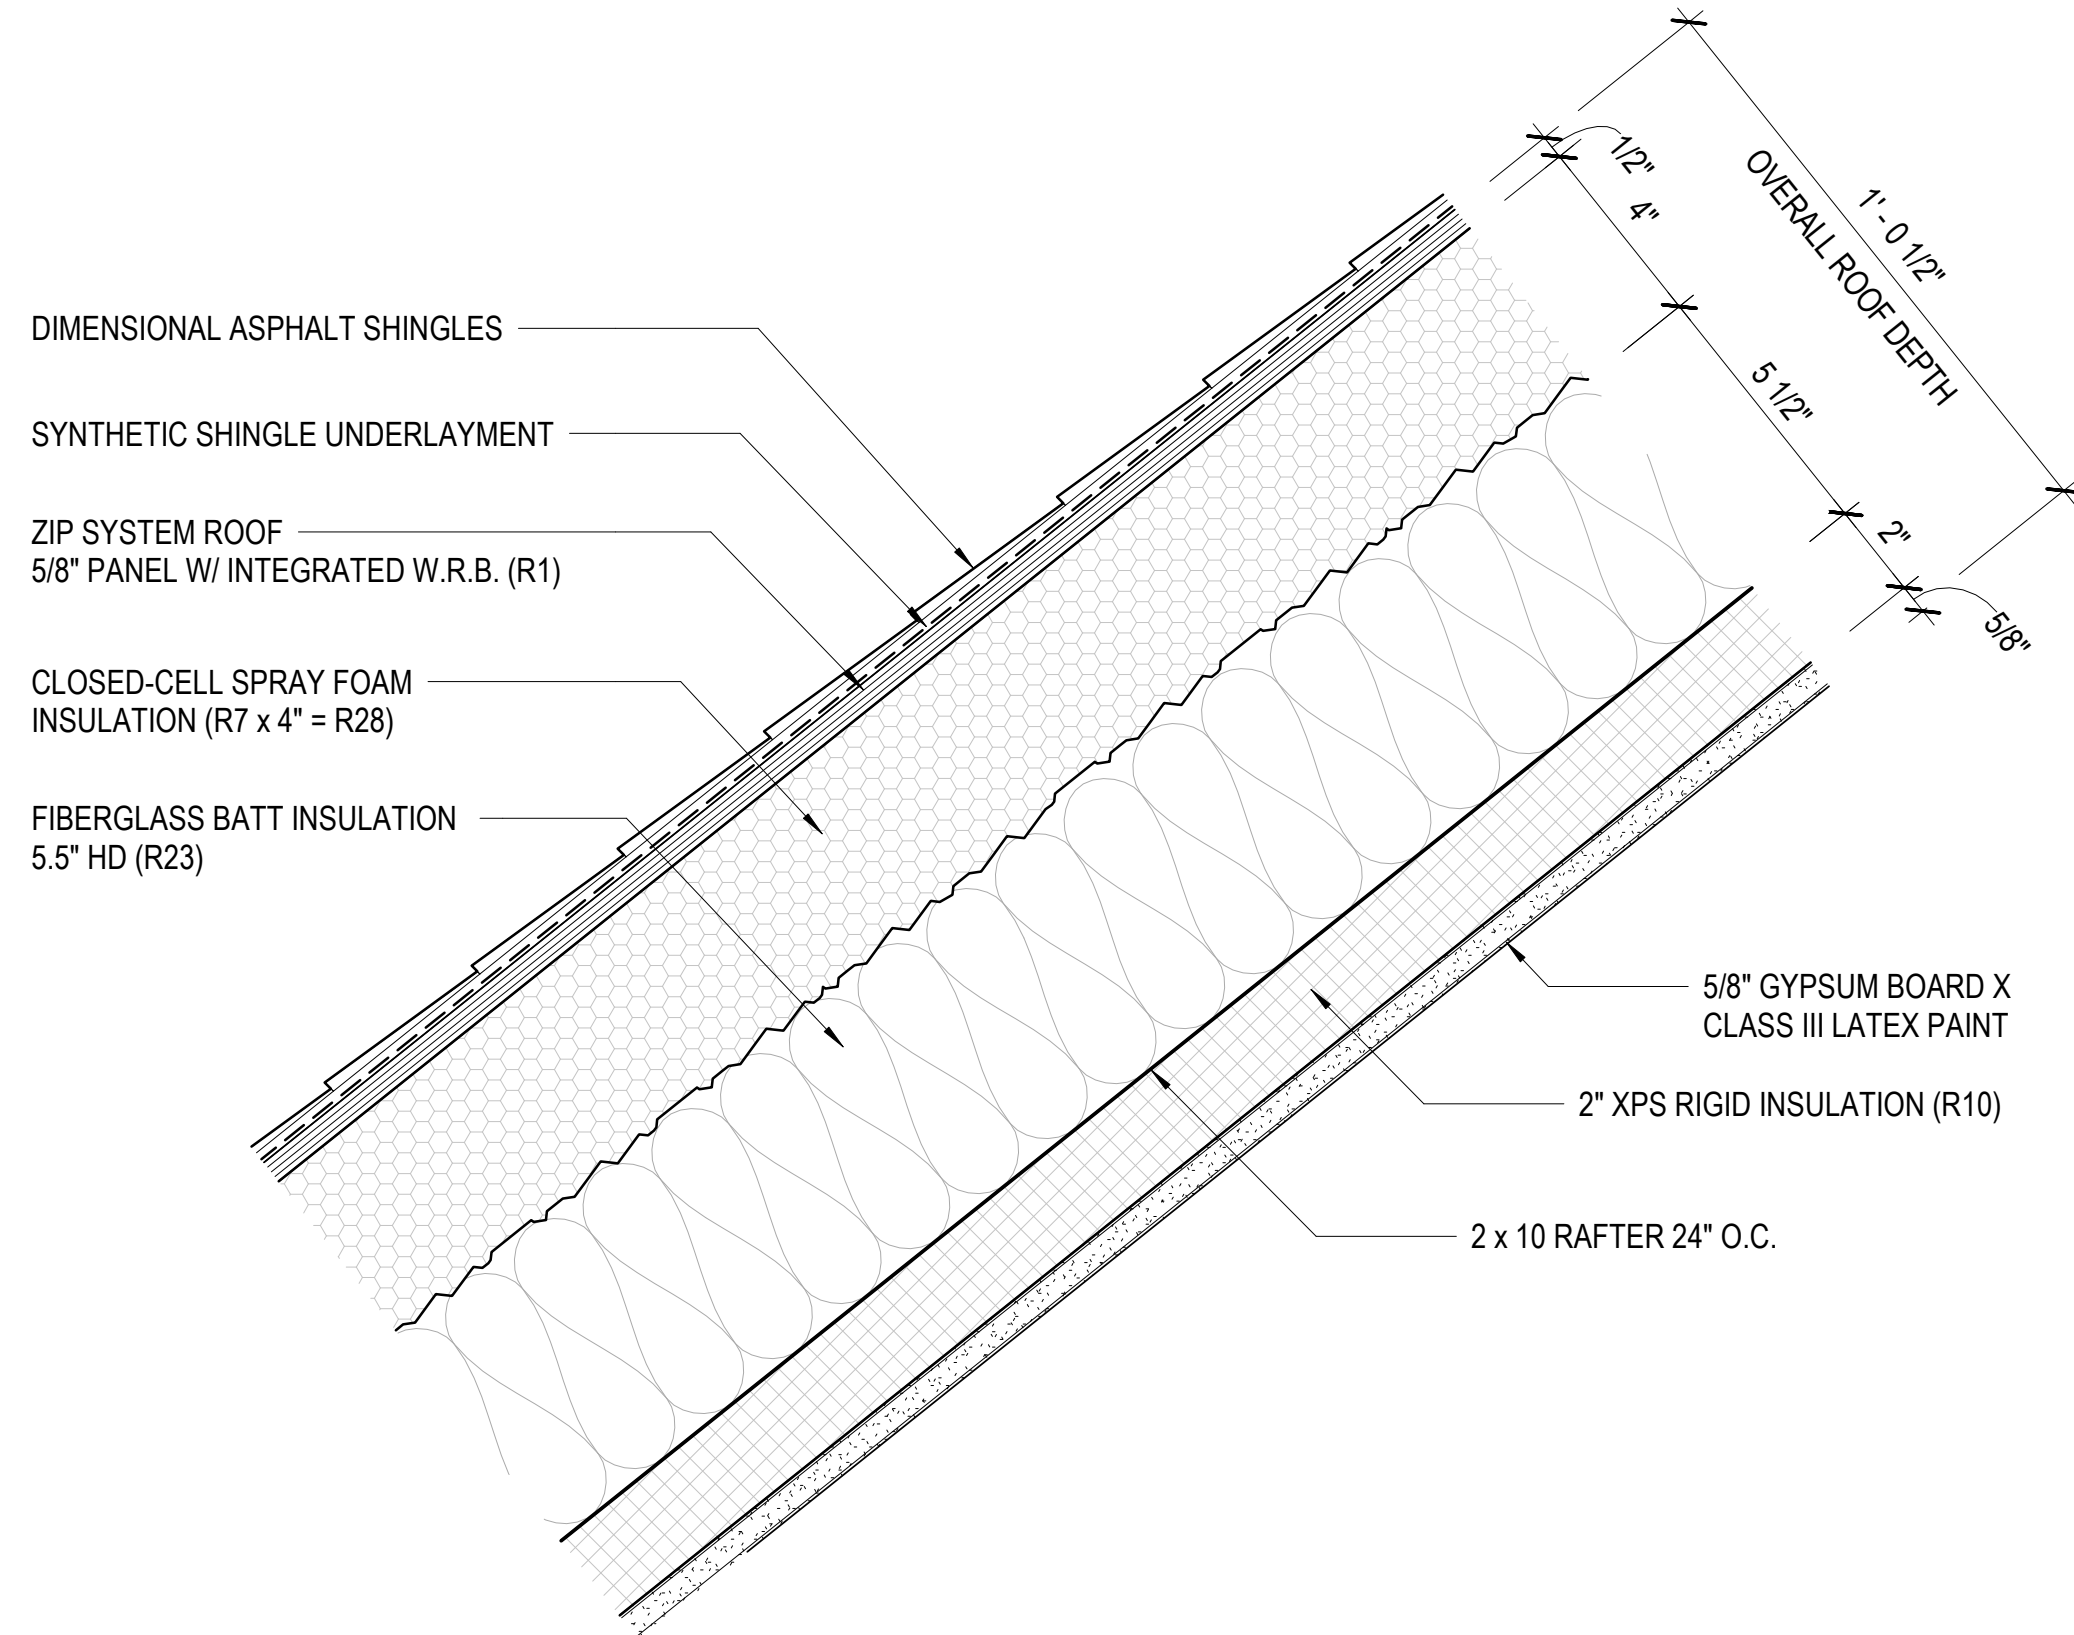


PL-1

R41.5

R-20 REQ. IN CLIMATE ZONE 5

WALL R-VALUE IS CALCULATED
BASED ON TOTAL WALL
ASSEMBLY INCLUDING A 22%
FRAMING FACTOR

BASE R-VALUE: 53
EFFECTIVE R-VALUE: 41.5

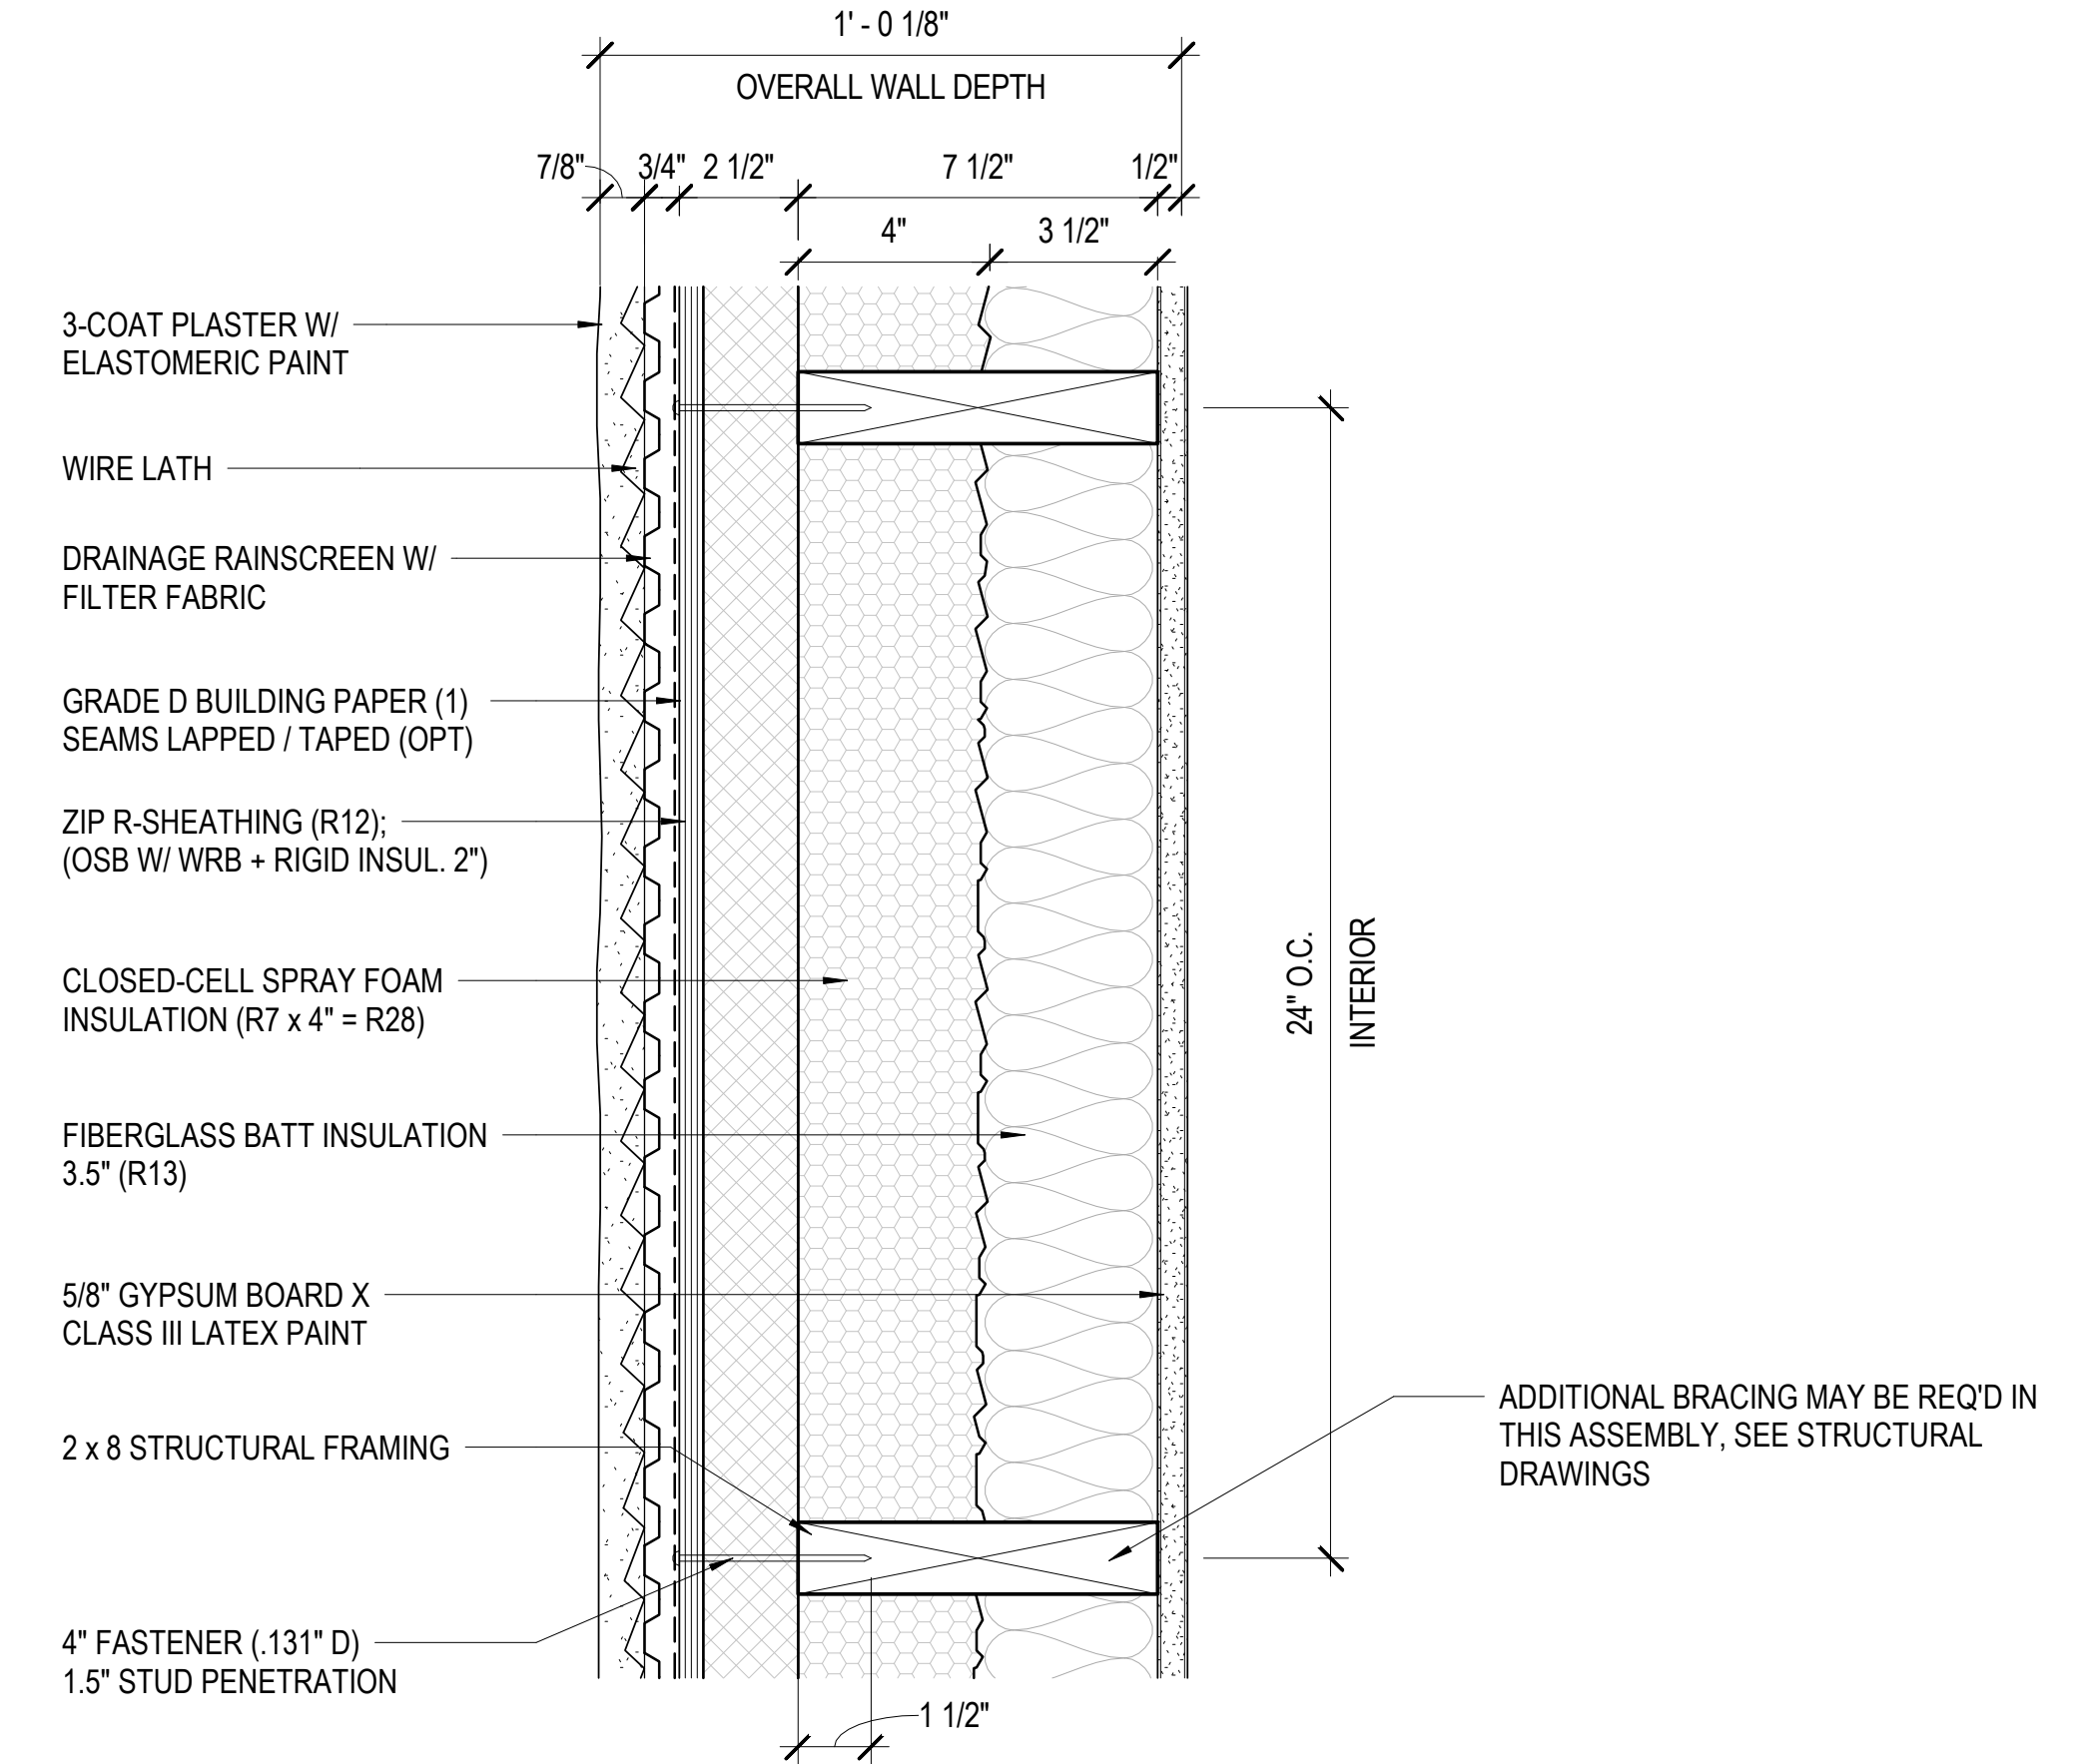

ADDITIONAL BRACING MAY BE REQ'D IN
THIS ASSEMBLY, SEE STRUCTURAL
DRAWINGS