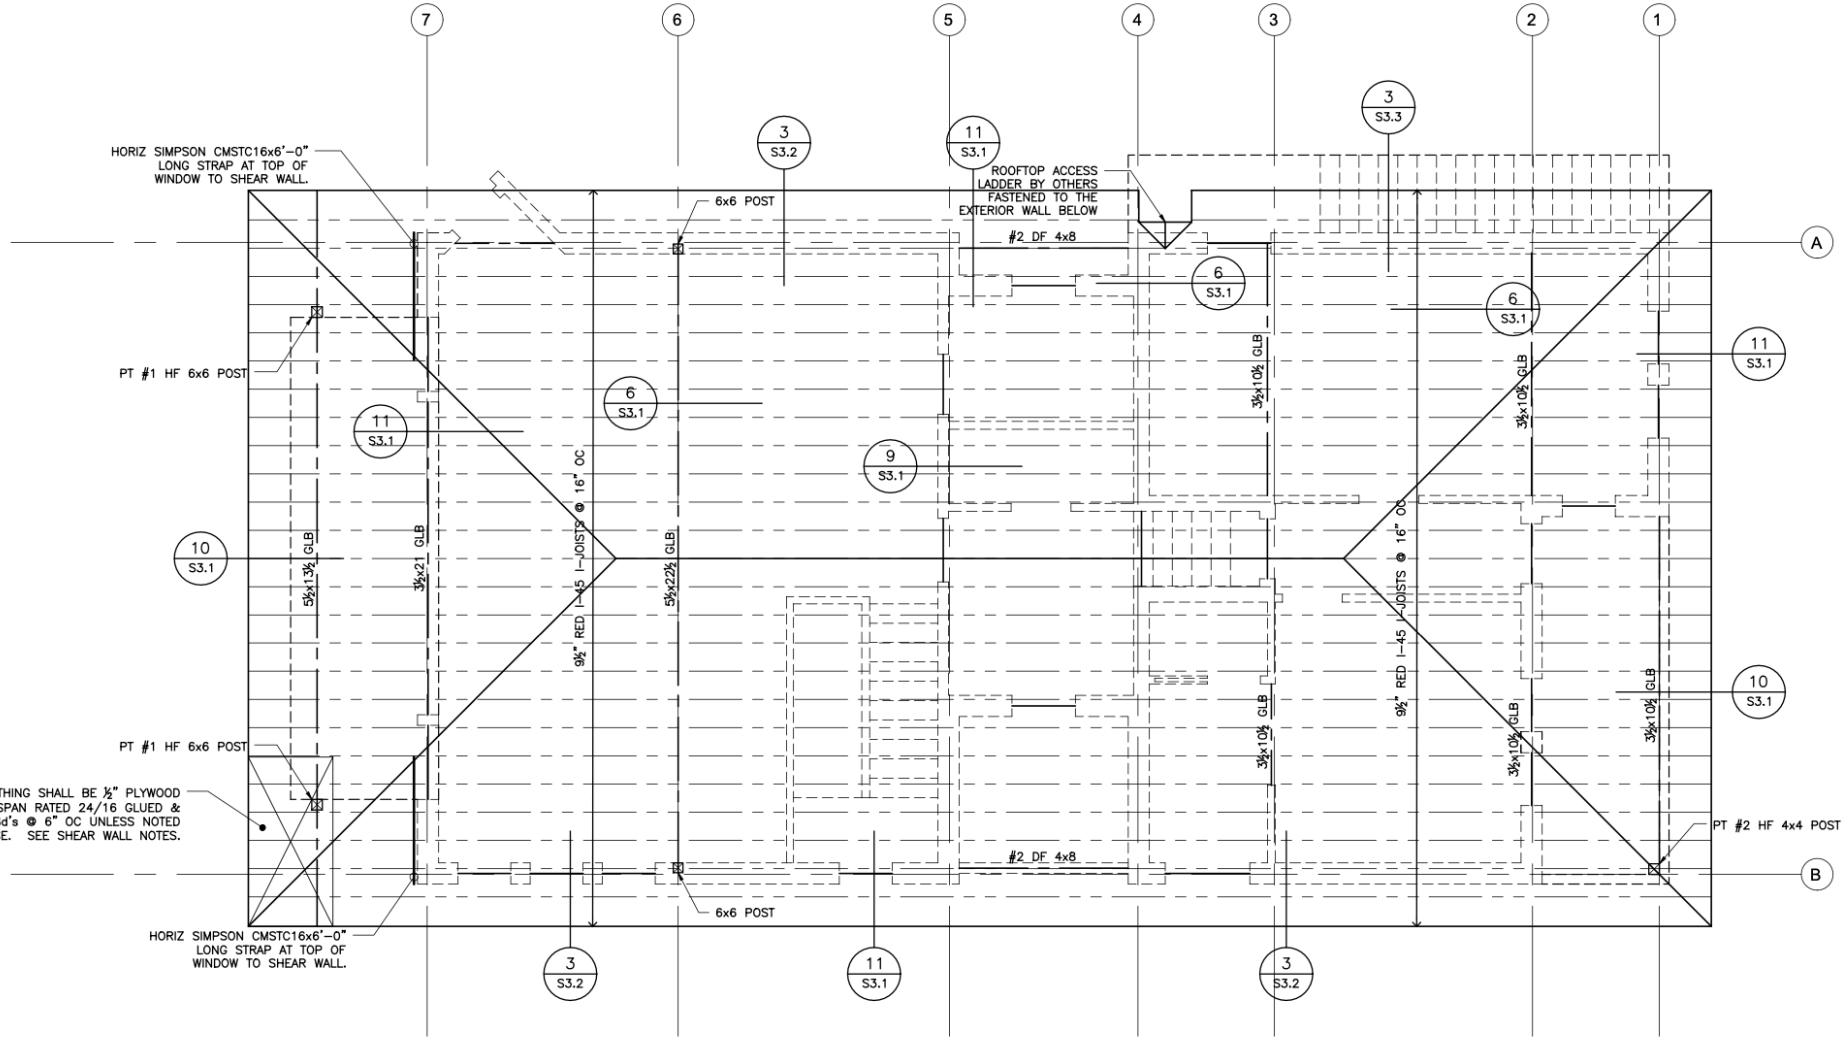
7
6
5
4
3
2
1
A
B
HORIZ SIMPSON CMSTC16x6'-0" LONG STRAP AT TOP OF WINDOW TO SHEAR WALL.
PT #1 HF 6x6 POST
PT #1 HF 6x6 POST
ROOF SHEATHING SHALL BE ½" PLYWOOD OR 7/16" OSB SPAN RATED 24/16 GLUED & NAILED W/ 8d's @ 6" OC UNLESS NOTED OTHERWISE. SEE SHEAR WALL NOTES.
HORIZ SIMPSON CMSTC16x6'-0" LONG STRAP AT TOP OF WINDOW TO SHEAR WALL.
6x6 POST
6x6 POST
ROOFTOP ACCESS LADDER BY OTHERS FASTENED TO THE EXTERIOR WALL BELOW
#2 DF 4x8
#2 DF 4x8
PT #2 HF 4x4 POST
5½x13½ GLB
3½x21 GLB
5½x22½ GLB
9½" RED I-45 I-JOISTS @ 16" OC
3½x10½ GLB
3½x10½ GLB
3½x10½ GLB
3½x10½ GLB
3½x10½ GLB
3½x10½ GLB
9½" RED I-45 I-JOISTS @ 16" OC
3 S3.2
11 S3.1
3 S3.3
6 S3.1
9 S3.1
10 S3.1