NOTES:
1. PROVIDE EXHAUST VENT TERMINAL FOR RANGE HOOD PER AHJ AND MANUFACTURER REQUIREMENTS. INCLUDE BACKDRAFT DAMPER.
2. PROVIDE EXHAUST, SUPPLY, AND INTAKE TERMINALS FOR ERV PER AHJ AND MANUFACTURER REQUIREMENTS.
3. SPACE ERV EXHAUST AND INTAKE TERMINALS PER AHJ AND MANUFACTURER REQUIREMENTS.

MECHANICAL EQUIPMENT SCHEDULE

Mark	Description	Manufacturer	Model
AHU	36MBH DUCTED SPLIT SYSTEM HEAT PUMP AHU.		03
ERV	100CFM ERV	Panasonic	FV-10VEC1
HP	36MBH HEAT PUMP		
RH	100CFM DUCTED RANGE HOOD		
RO	20GPM REVERSE OSMOSIS WATER FILTER		
WH	50GALLON HEAT PUMP WATER HEATER		

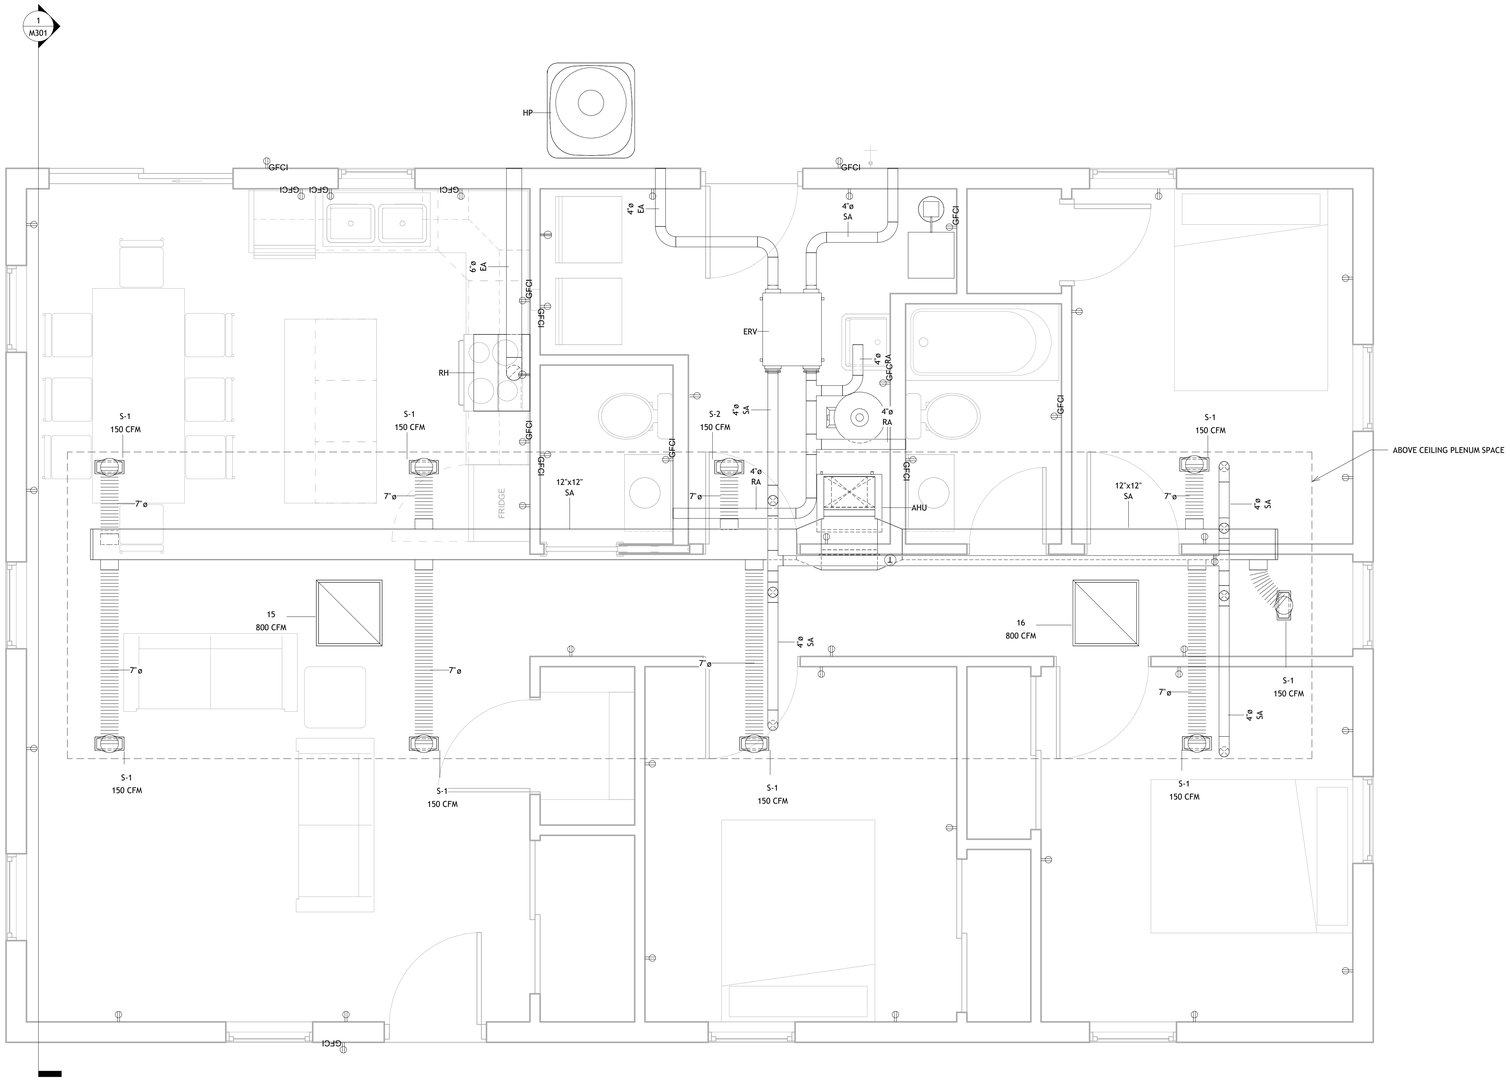

1 First Floor Mechanical Plan
1/2" = 1'-0"

N

0 1' 2' 4'
0 1' 2'
1/2" = 1'-0"

AUTODESK

www.autodesk.com/revit

Consultant
Address
Address
Address
Phone

Consultant
Address
Address
Address
Phone

Consultant
Address
Address
Address
Phone

Consultant
Address
Address
Address
Phone

Consultant
Address
Address
Address
Phone

No.	Description	Date

Johnson House

Mechanical Plans

Project Number	Project Number
Date	Issue Date
Drawn By	Author
Checked By	Checker

M101

Scale	1/2" = 1'-0"

3/10/2026 7:57:58 AM